

Bayesian benchmarking of off-normal occurrence rates for US underground natural gas storage facilities

Richard Schultz¹, Douglas Hubbard², David Evans³, and Sam Savage⁴

¹Orion Geomechanics LLC

²Hubbard Decision Research

³British Geological Survey

⁴ProbabilityManagement.org

November 26, 2022

Abstract

Defining a baseline for the frequency of off-normal occurrences at underground natural gas storage facilities is critical to maintaining safe operation and to the development of appropriate risk management plans and regulatory approaches. Currently used frequency-estimation methods are broadened to include critical factors of cause, severity, and uncertainty that contribute to risk. A Bayesian probabilistic analysis characterizes the aleatoric historical occurrence frequencies given imperfect sampling. Occurrence frequencies for the three main storage facility types in the United States (depleted oil-and-gas field storage, aquifer storage, solution-mined salt cavern storage) are generally on the order of 3 to 9 x 10⁻² occurrences, of all causes (surface, well integrity, subsurface integrity) and severities (nuisance, serious, catastrophic), per facility-year. Loss of well integrity is associated with many, but not all, occurrences either within the subsurface or from there up to the surface. The probability of one serious or catastrophic leakage occurrence to the ground surface within the next 10 years, assuming constant number of facilities, is approximately 0.1–0.3% for any facility type. Storage operators and industry regulators can use occurrence frequencies, their associated probabilities and uncertainties, and forecasts for severity magnitudes to better prioritize resources, establish a baseline against which progress toward achieving a reduction target is measured, and develop more effective mitigation/monitoring/reduction programs in a risk management plan.


Bayesian Benchmarking of Off-Normal Occurrence Frequencies for US Underground Natural Gas Storage Facilities

Richard A. Schultz (Orion Geomechanics LLC, Cypress, TX, USA; oriongeo@gmail.com)



Douglas W. Hubbard (Hubbard Decision Research, Glen Ellyn, IL, USA; dwhubbard@hubbardresearch.com)

David J. Evans (British Geological Survey, Keyworth, Nottingham, UK; devans50.de@gmail.com)

Sam L. Savage (ProbabilityManagement.org, Stanford, CA; sam@probabilitymanagement.org)

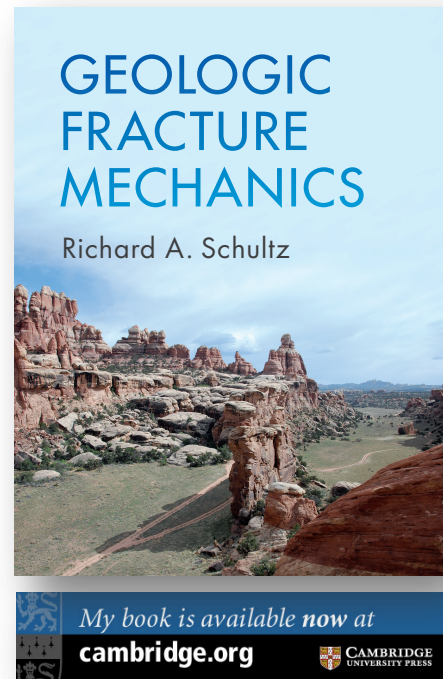

Types of UGS Storage Facilities (US): 386 ±

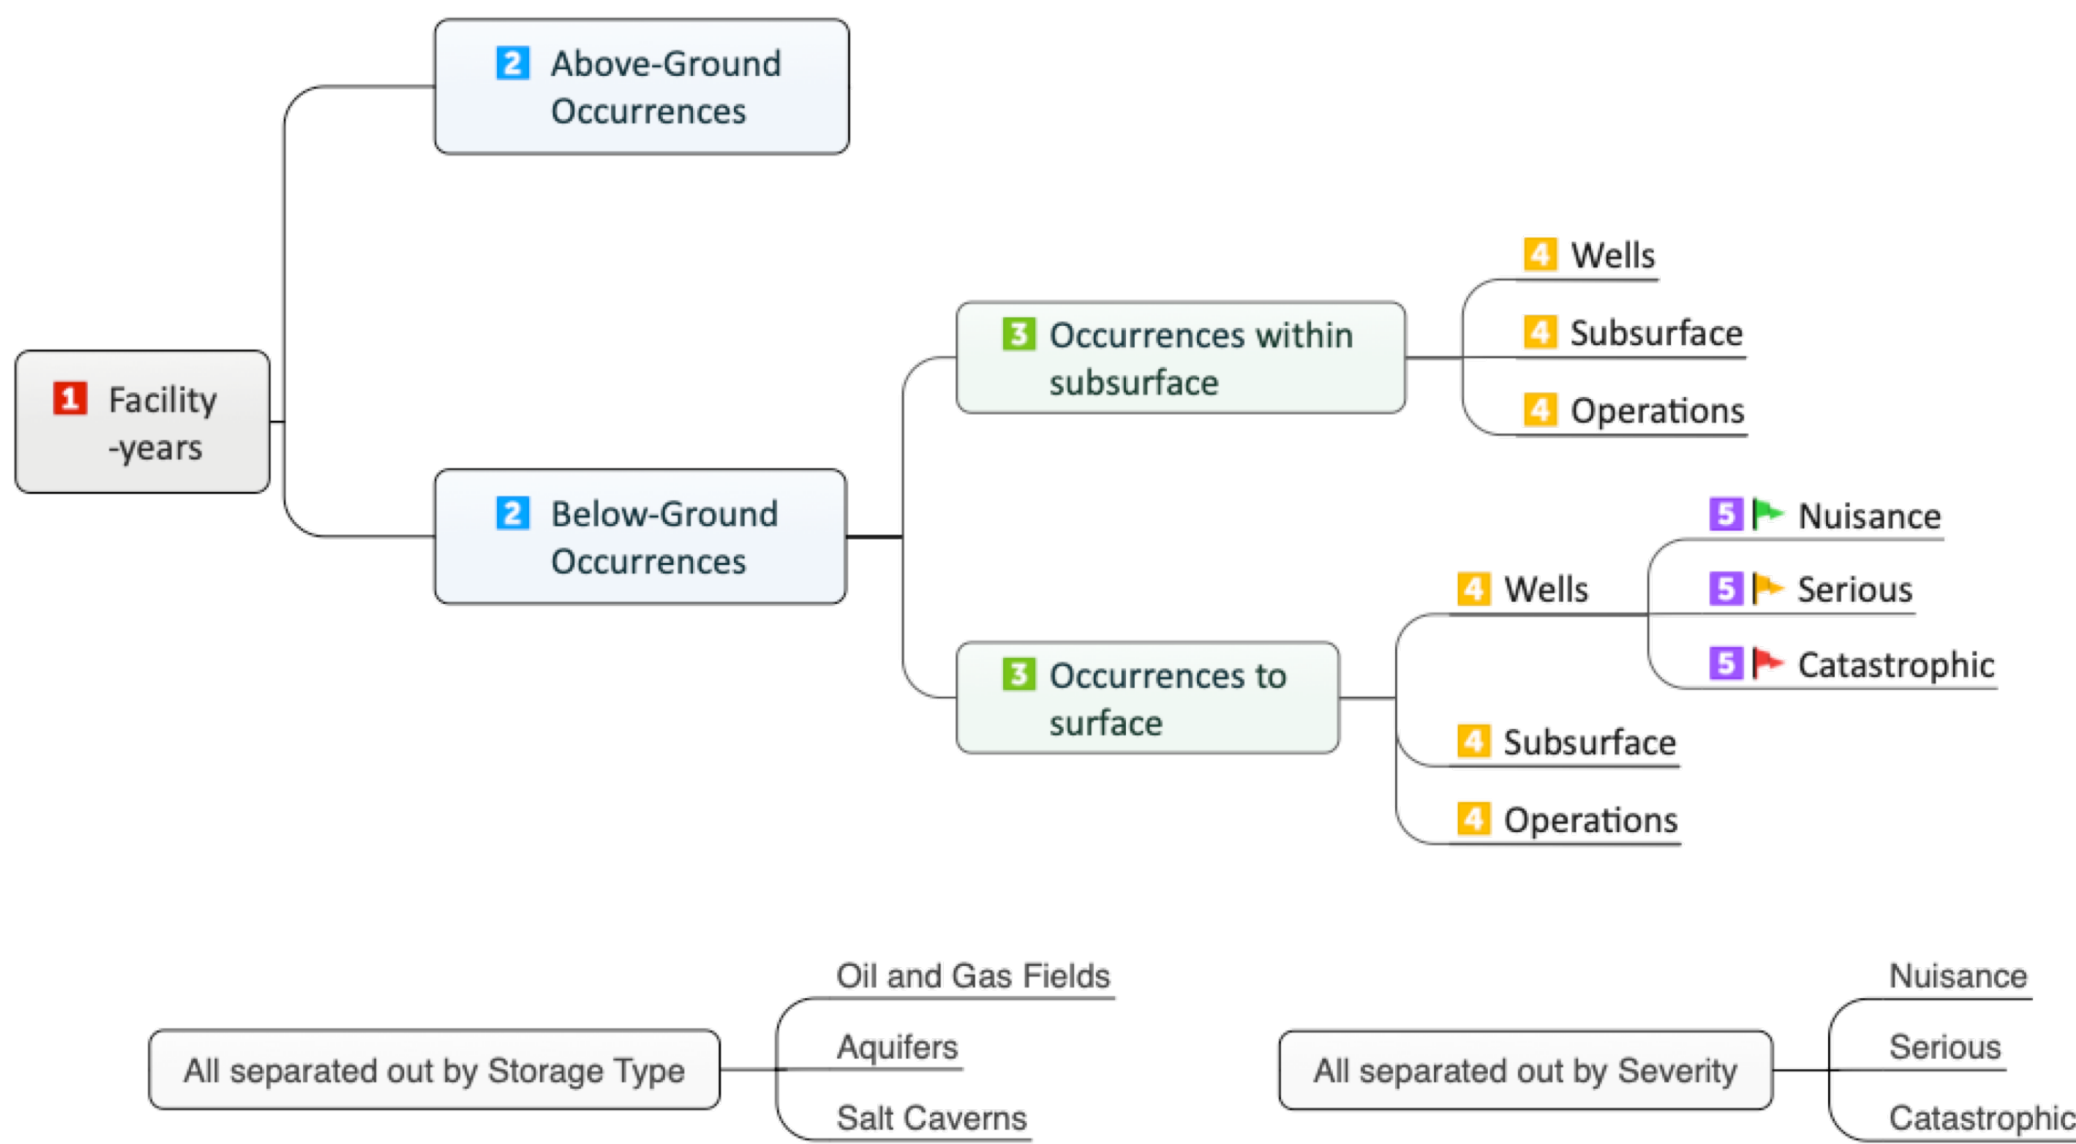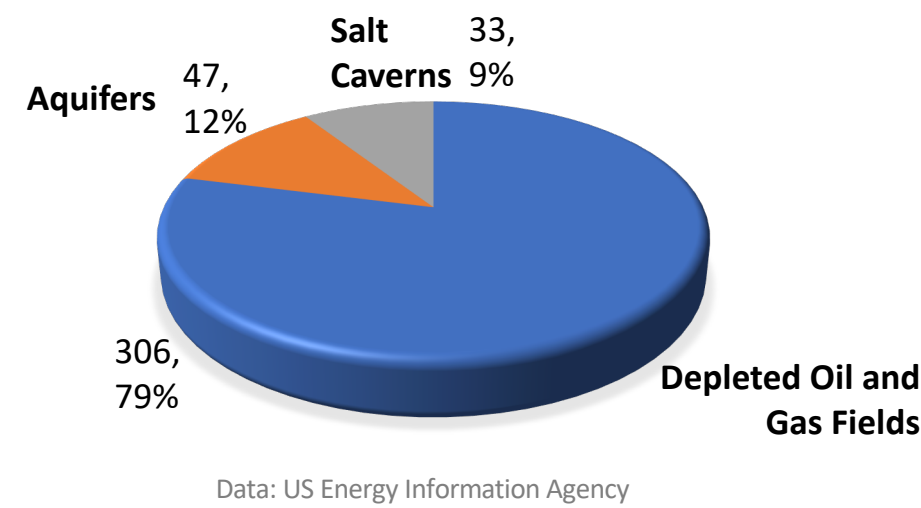

Natural gas (methane) is a critically important component to the energy economies of the United States and other countries. Because storage capacity in the above-ground pipeline network is insufficient to meet demand, natural gas is stored in large underground (UGS) facilities.

Defining a baseline for the frequency of reported and documented *off-normal occurrences* ($\equiv$ any reported or documented issue, event, incident, accident, or failure with or without leakage arising during routine operations at any given facility, of any cause or magnitude of severity, that may have involved human error, process safety, mechanical or operational issues, or natural events) at UGS facilities is critical to maintaining safe operation and to the development of appropriate risk management plans and regulatory approaches.

A Bayesian probabilistic analysis characterizes the historical US occurrence frequencies. Frequencies for the three main UGS facility types are 3 to 9 x 10⁻² occurrences per facility-year, of all causes and severities. Loss of well integrity is associated with many, but not all, occurrences.


Well integrity loss contributes to

- 72% of occurrences within the geologic subsurface, all severities
- 91% of occurrences to the ground surface, all severities

Operators and regulators can

- Choose risk tolerance (e.g., 1%) and identify frequency reductions that can achieve this
- Quantify probabilities for occurrences by cause, field type, degree of severity
- Assess success of Risk Management Plans by comparing targets to baseline

3 main types of UGS facilities showing the underground storage component and the transport (pipeline) component of the midstream oil-and-gas sector

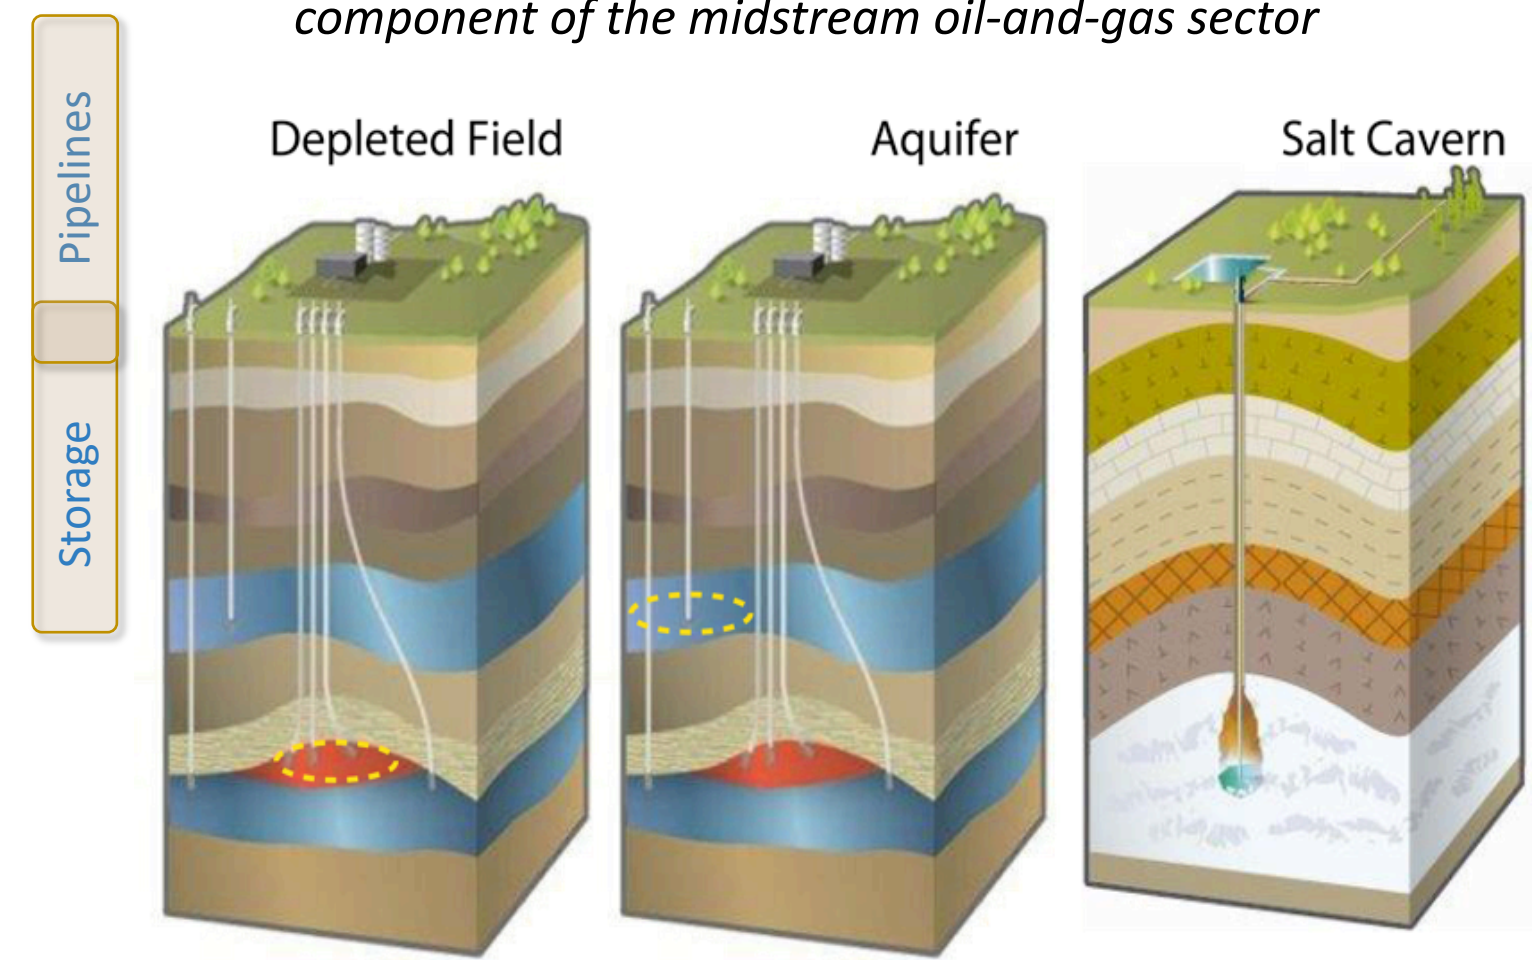

Calculated Bayesian occurrence frequencies to surface per facility-year for increasing severity magnitude group, wells and subsurface causes combined. Note reversed scale for occurrence frequency, decreasing toward top of figure. Small filled symbols, scalar arithmetic mean frequencies of number of occurrences to surface per facility-year; larger filled symbols are Bayesian occurrence frequencies for each facility type with P5, P50, and P95 exceedance probabilities shown by error bars. Values for aquifer mean occurrence frequencies of zero are not plotted.

Arithmetic Averages

$$\text{Frequency} = \frac{\text{Number of Occurrences}}{(\text{Number of Facilities})(\text{Number of Years})}$$
$$\text{or} = \frac{\text{Number of Occurrences}}{(\text{Number of Wells})(\text{Number of Years})}$$



Example: 0.005 or 5 x 10⁻³

- Increases with number of occurrences, decreasing number of facilities
- Decreases with increasing years of operation
- Uncertainties rarely calculated
- New estimates made in isolation from previous ones

Bayesian inversion was used to calculate the probability of an occurrence frequency that was incompletely sampled by the historical occurrence data. The frequency of occurrences was modeled by a binary choice (occurrence/no occurrence) per facility-year, corresponding to a Bernoulli trial and calculated using the BETAINV and BINOM.INV functions in Excel™

Bayesian Statistics: Binomial Distribution

- Models occurrence frequency relative to a random number of (yes/no) occurrences
- Provides probability (likelihood) of occurrences at given frequencies
- Compares new data against prior values to update frequencies using new numbers for facilities, wells, years of operation, and occurrences

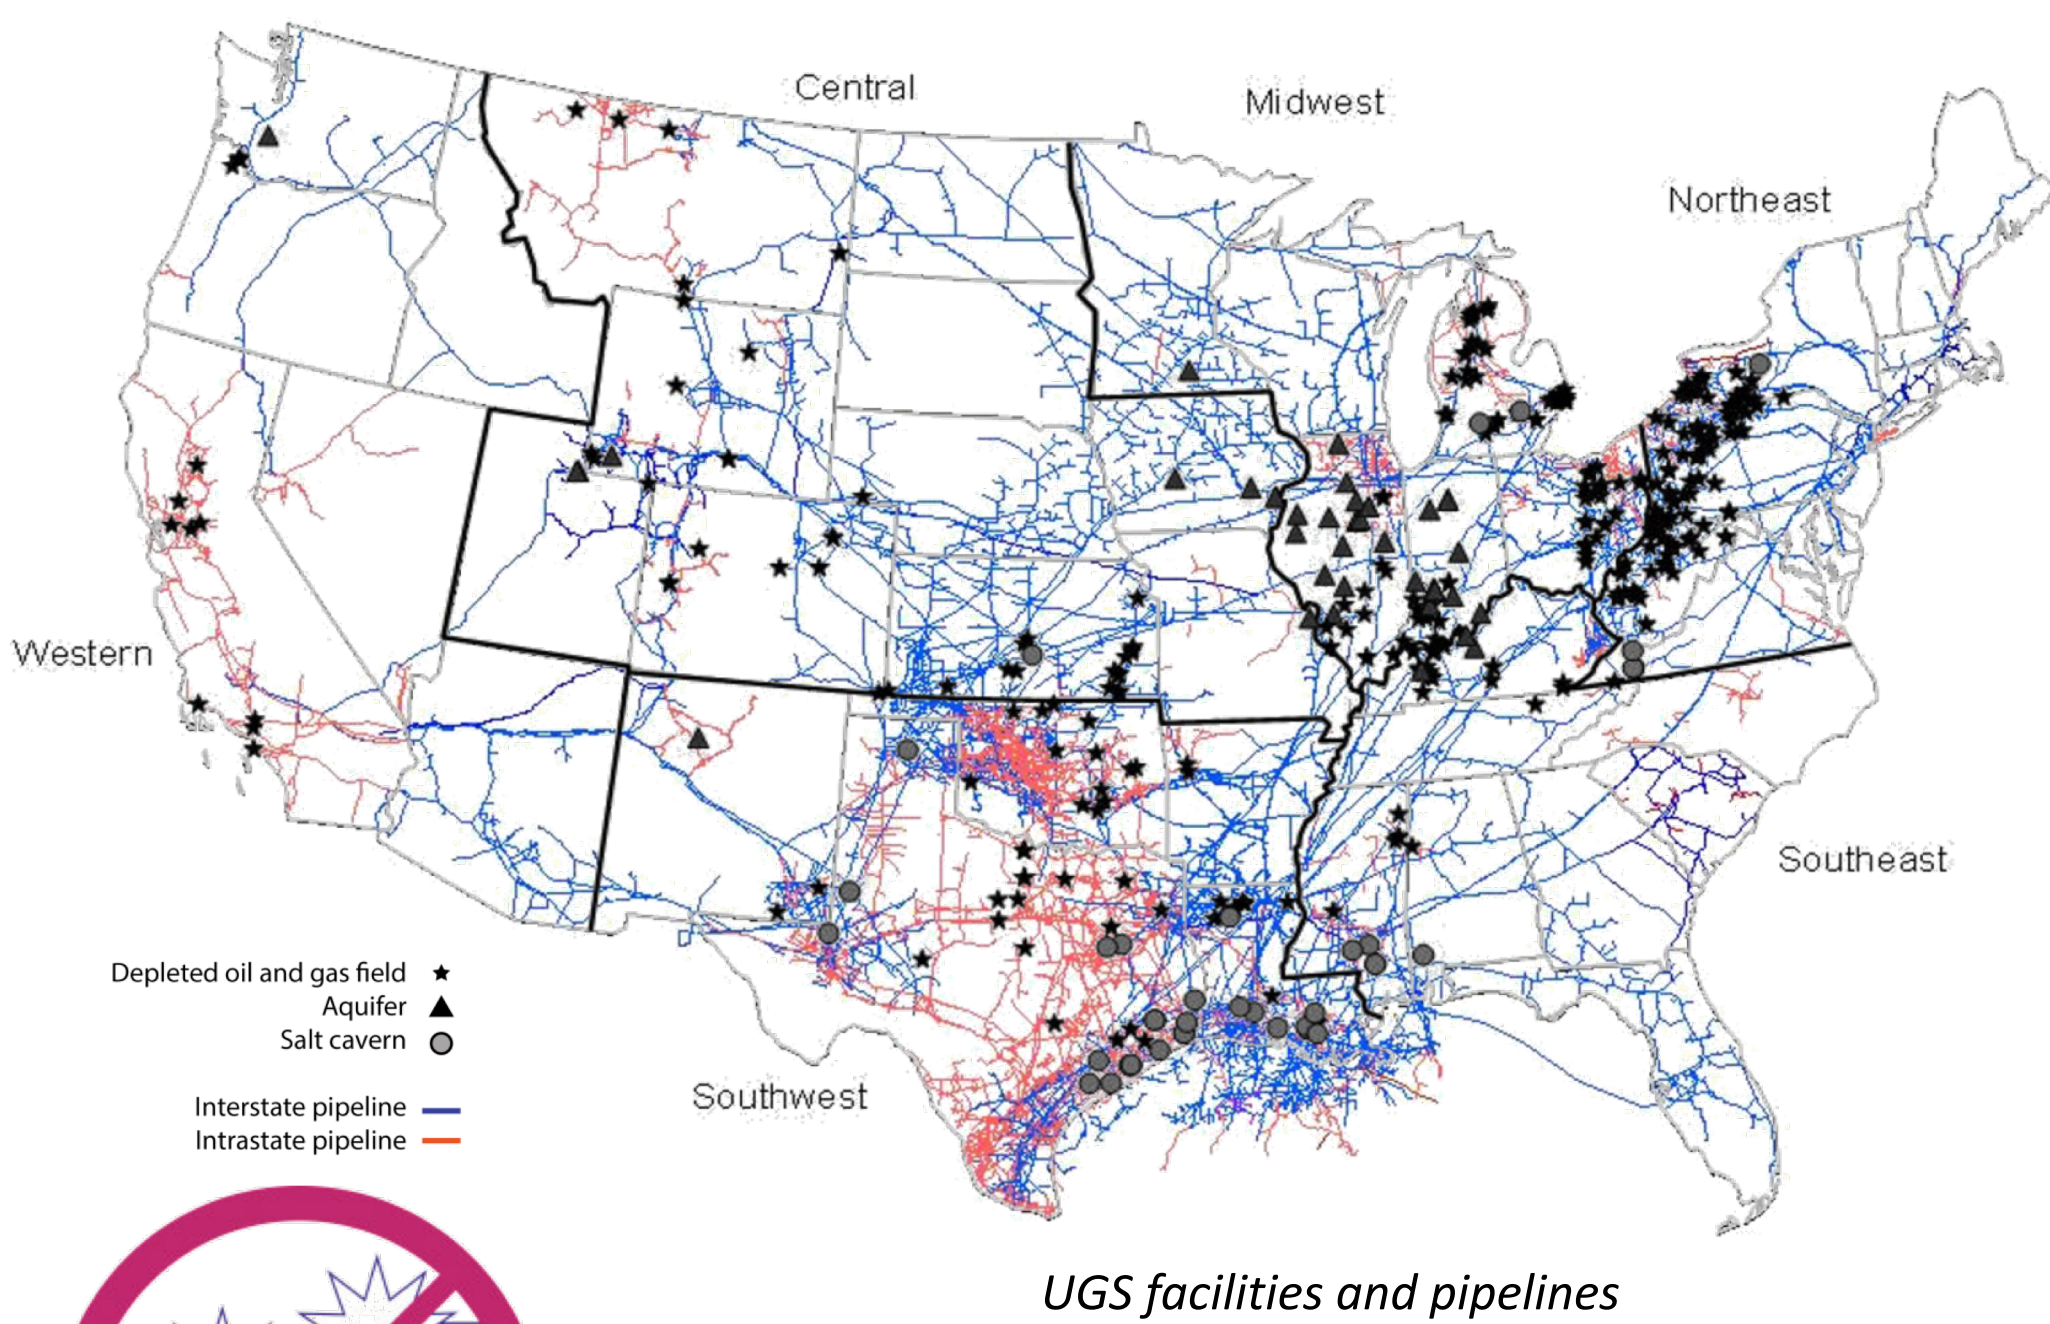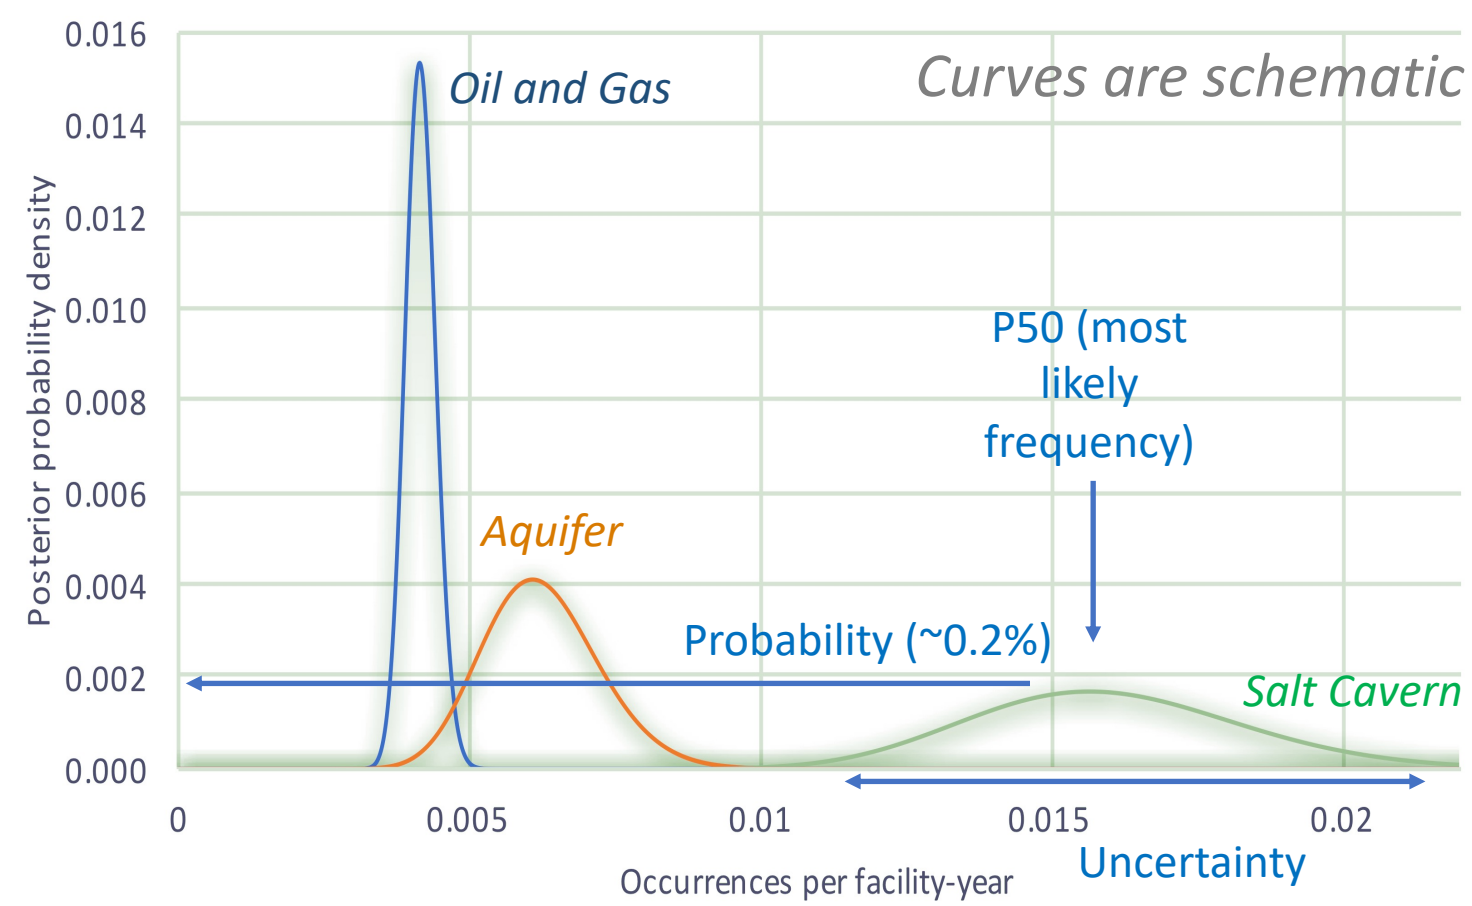

NO PHOTOS

Material was drawn from a paper by the same authors that has been accepted for publication in *Risk Analysis*

